


Recc all piping to be sized per ASHRAE F36



Note: This drawing shows suggested piping configuration. Check with local codes and ordinances for additional requirements.

PROJECT NAME:		DRAWING TITLE:	
PROJECT LOCATION:		HYDRONIC PRIMARY/SECONDARY - 3 ATMOSPHERIC BOILERS, INDIVIDUAL FPE VALVE, WITH SYSTEM PUMP	
ENGINEER:		DRAWING No. H-PS-100-3IF-1	
DATE:		DESIGNED BY: RSG 05/28/08	
BY:		CHECKED BY: [Blank]	
DESCRIPTION:		TOLERANCES UNLESS OTHERWISE SPECIFIED: SIZE D, SCALE NTS	
REV A RELEASED		DATE 05/23/08	
REV [Blank]		DATE [Blank]	

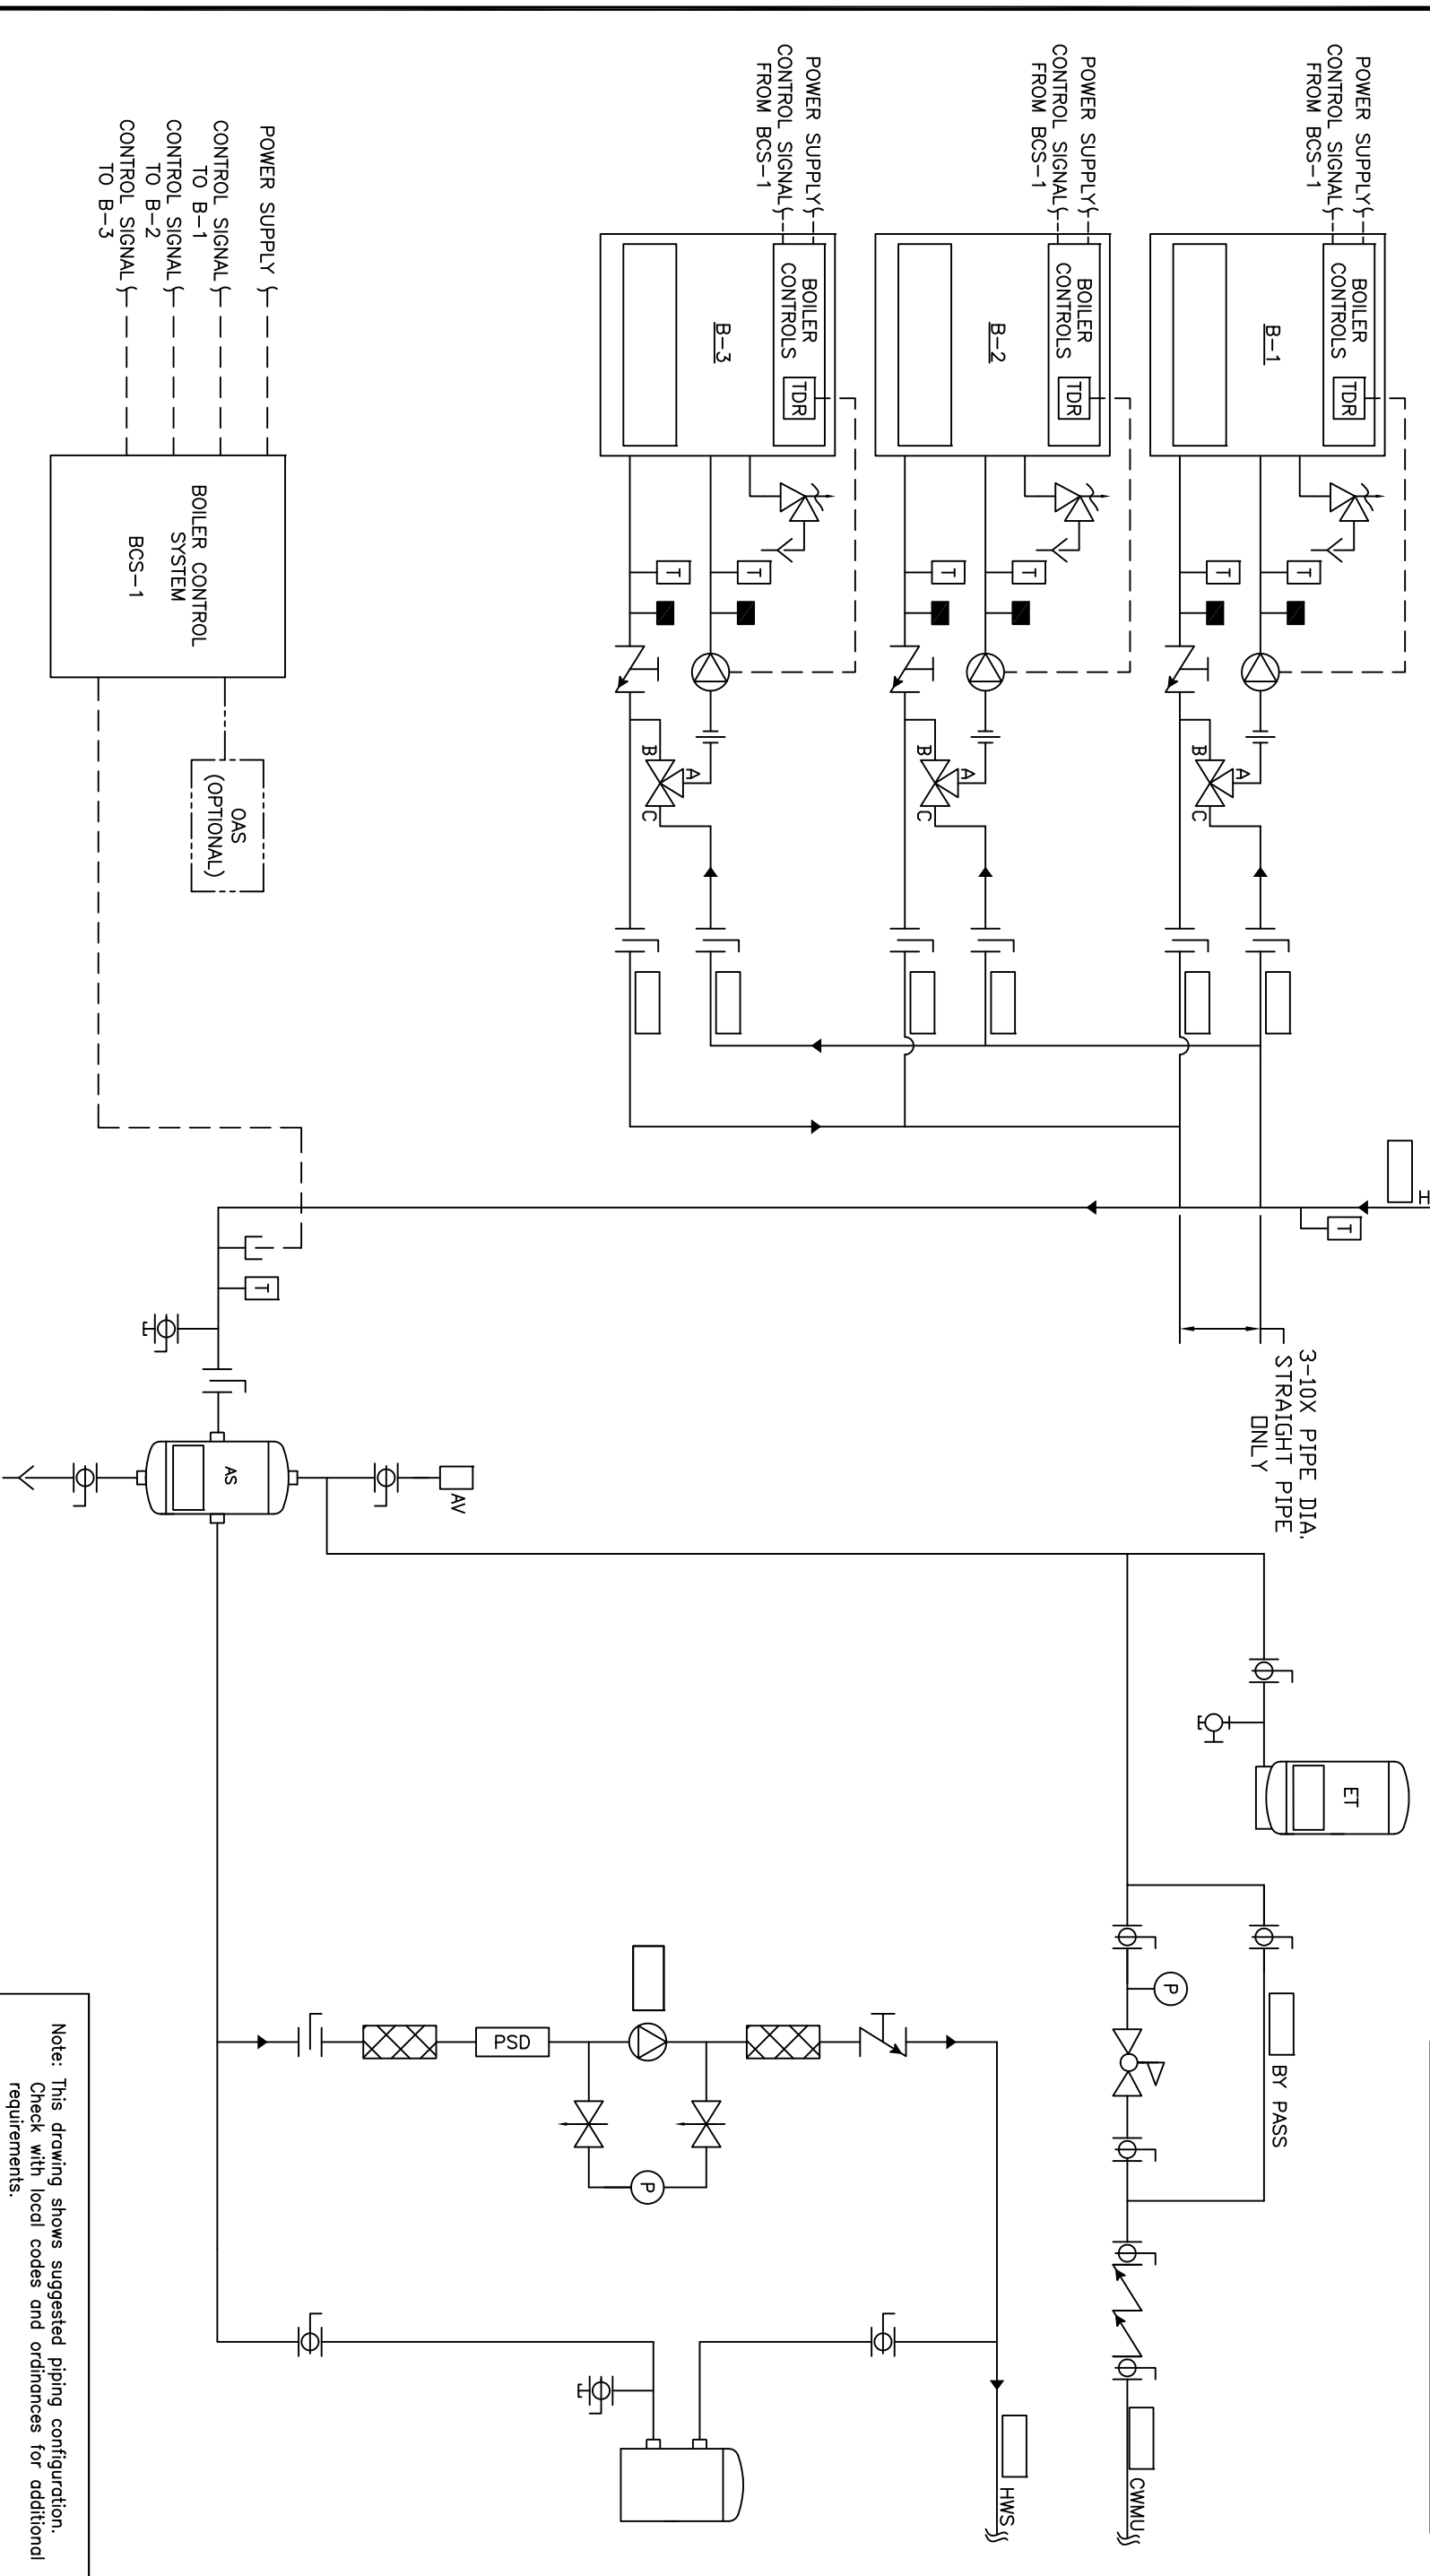